

GENERAL NOTES

- SEE ONE LINE DIAGRAM ON SHEET E-601 FOR SERVICE INFORMATION.
- SEE DUCT BANK AND GROUNDING DETAILS ON SHEET E-501.
- SEE GENERATOR CONCRETE PAD DETAIL ON SHEET E-50A.
- EC SHALL REPLACE CONCRETE SIDEWALK REMOVED FOR DUCT BANK INSTALLATION AND GAS LINE INSTALLATION TO GENERATOR.
- CONTRACTOR SHALL COORDINATE METER SOCKET LOCATION WITH MET-ED AND WORK AT GAS METER TO ENSURE 3'-0" SEPARATION BETWEEN ELECTRIC METER AND GAS METER HEADER. MET-ED WILL PROVIDE ENCASED DUCT BANK AND CONDUCTORS FROM STREET HAND HOLE TO ELECTRIC METER SOCKET. CONTRACTOR SHALL EXTEND CONDUIT STUB-UP FROM DUCT BANK TO METER SOCKET. CONTRACTOR SHALL INCLUDE TRENCH INSPECTION FOR DUCT BANK WITH LOCAL INSPECTOR AND CONCRETE SIDEWALK REPLACEMENT WITHIN THE PROJECT SCOPE OF WORK.



BUCHART HORN
 BUCHART HORN ARCHITECTS
 445 West Philadelphia Street
 YORK, PA 17401
 717.852.1400


**READING FIRE DEPARTMENT ENGINE 3, 3 rd & COURT
 ELECTRICAL SERVICE, GENERATOR, & BOILER REPLACEMENT**
 15 N 3 rd STREET
 READING, PA
 DEPARTMENT OF PUBLIC WORKS, CITY OF READING, PENNSYLVANIA
 815 WASHINGTON ST.
 READING, PA

REVISIONS	MARK	ISSUED DATE	DESCRIPTION
	1	06/30/2020	ADDENDUM NO. 1

PROJECT NO: 81083-01
 ISSUED DATE: 06/12/20
 DRAWN BY: CLM
 CHECKED BY: JJG
 © BUCHART HORN, INC.
 SHEET TITLE:

ELECTRICAL SITE PLAN

SHEET NO: E-003

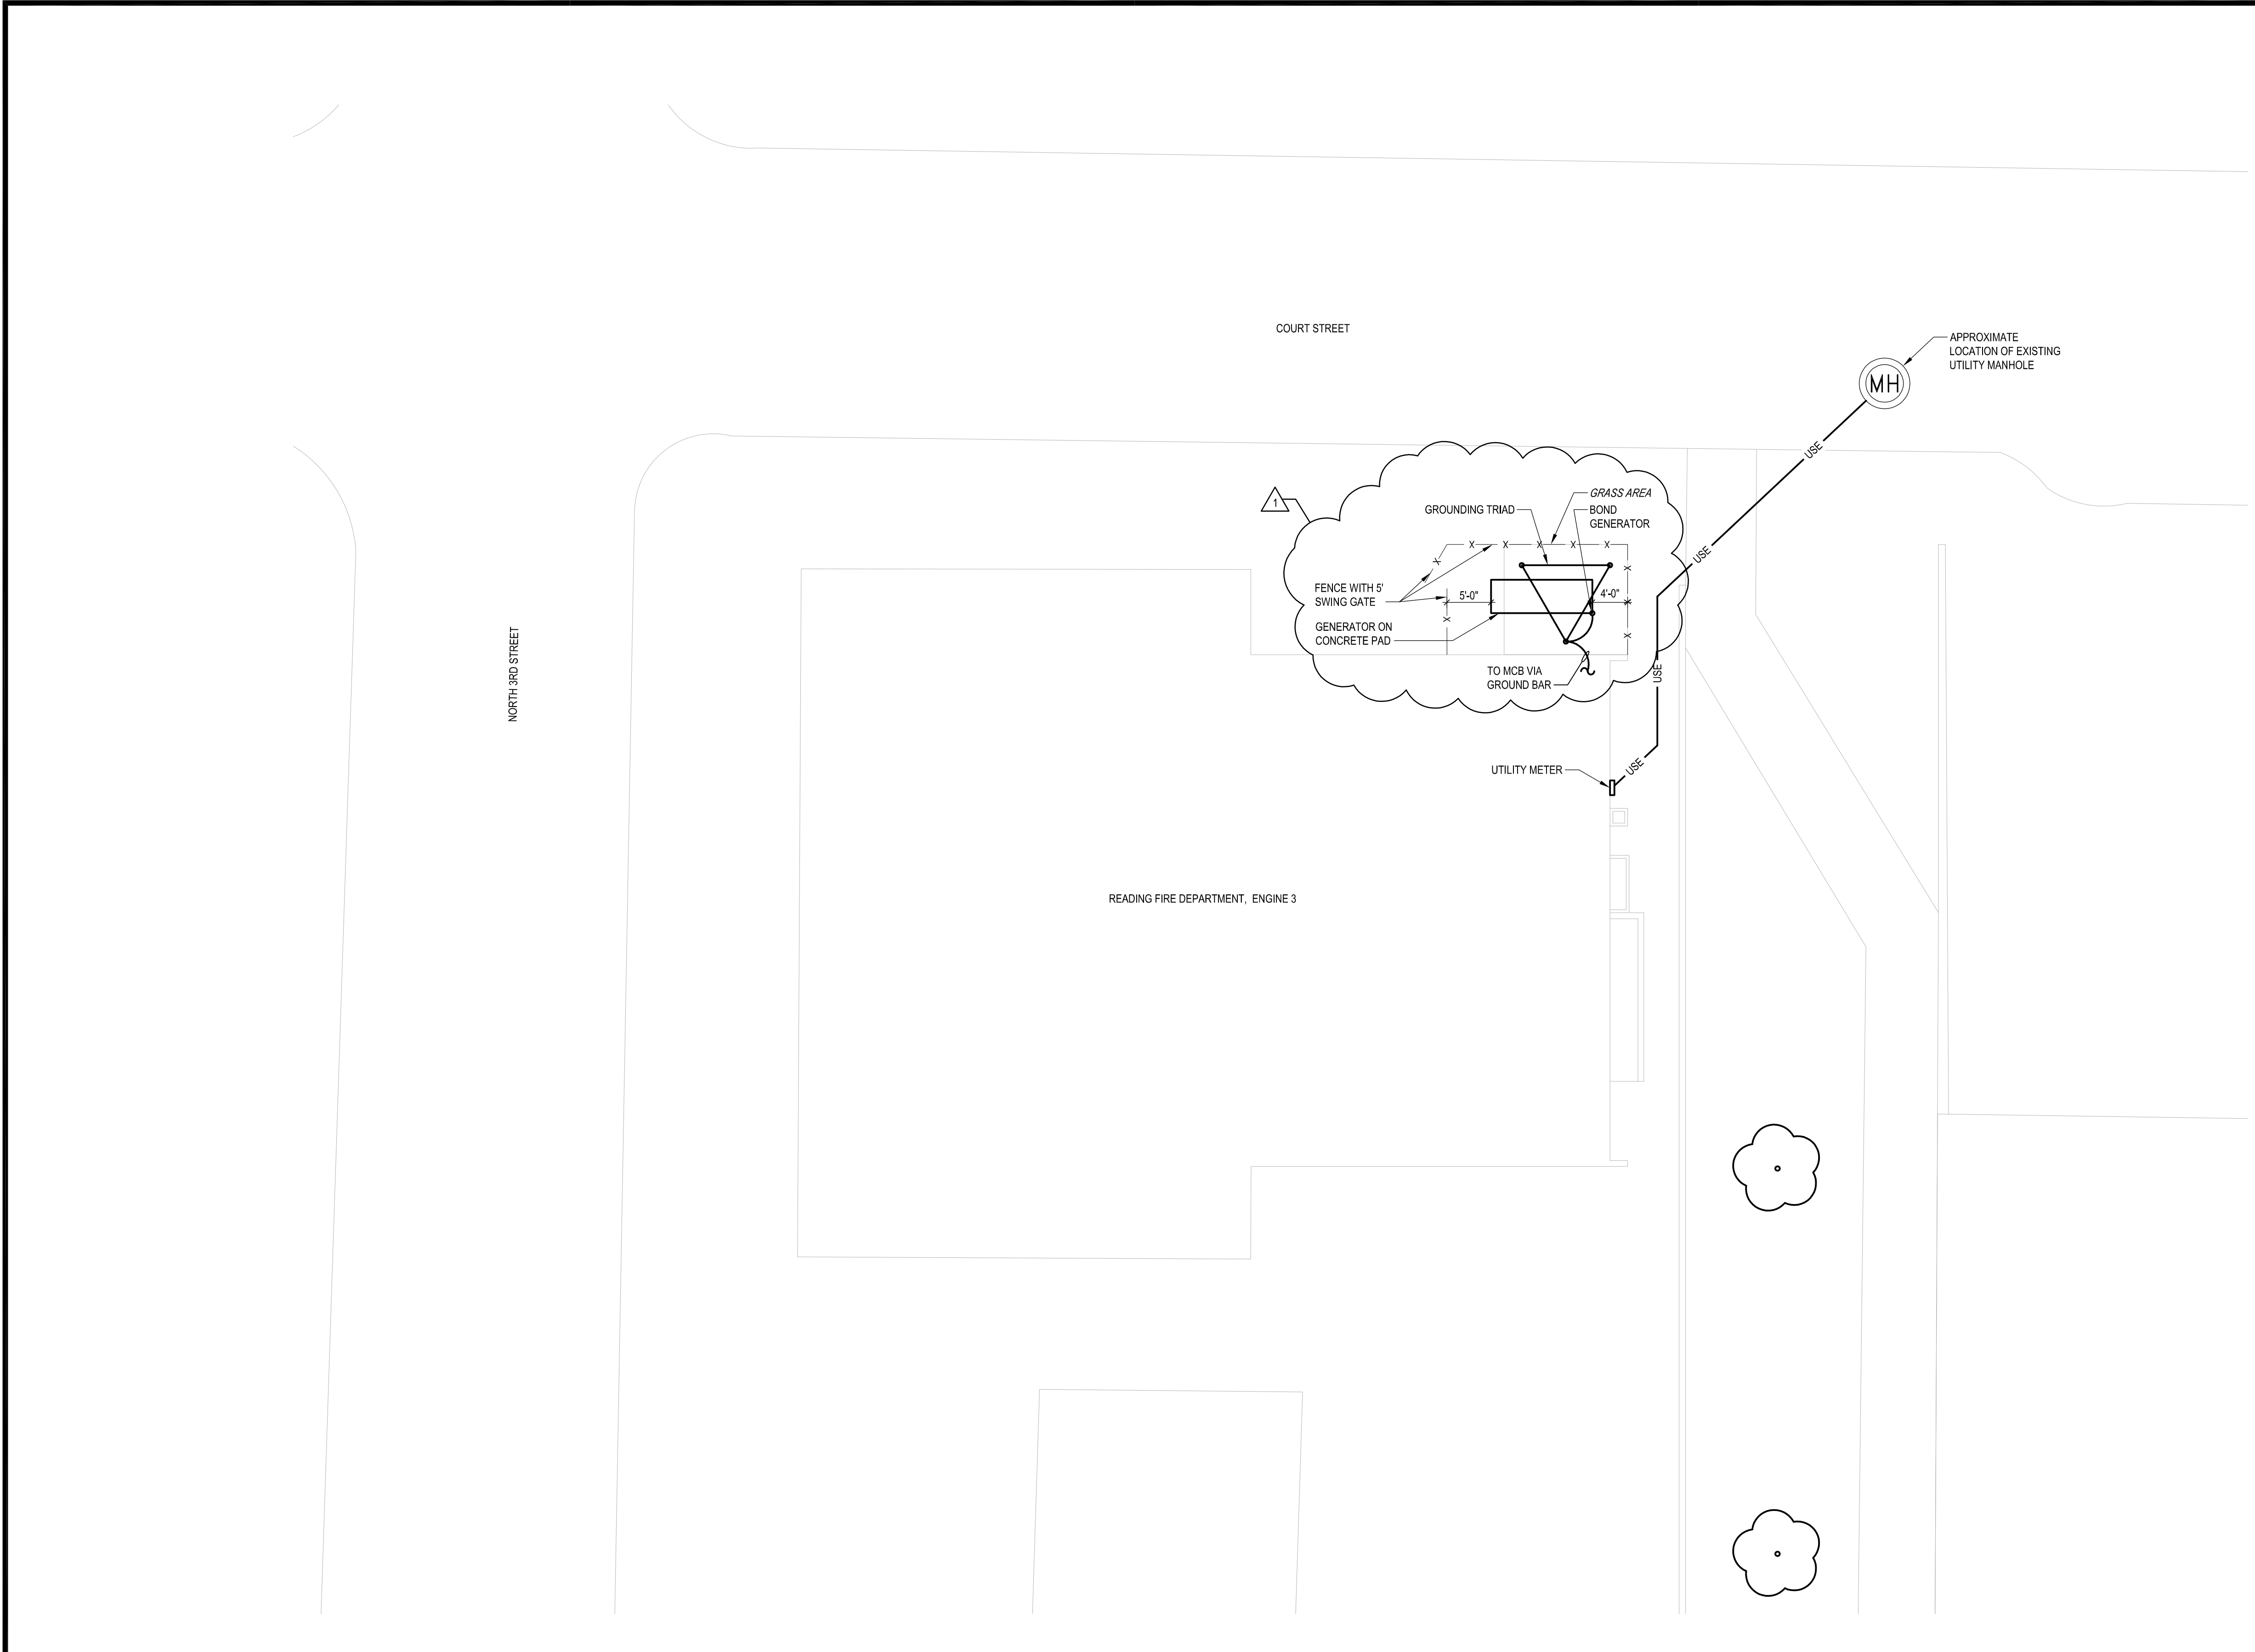

1 ELECTRICAL SITE PLAN
 SCALE: 1" = 10'
 PROJECT NORTH